


INSIDE DEDUCT WATER METER

A = INTERNAL PLUMBING AND FIXTURES
 B = EXTERNAL WATER USES

TYPICAL HOUSE

OUTSIDE FAUCET / HOSE BIB

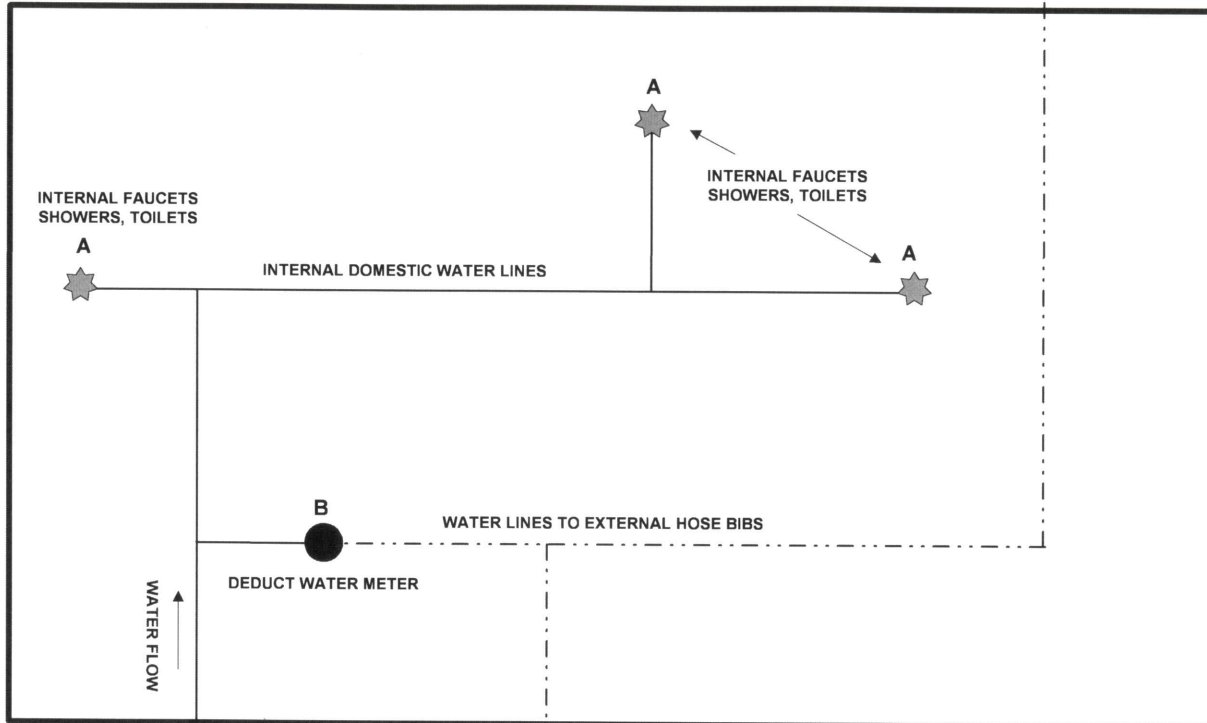

DOMESTIC WATER METER

AN ASSE 1011 VACUUM BREAKER IS REQUIRED FOR ALL HOSE BIBS



OUTSIDE FAUCET / HOSE BIB

B

WATER MAIN


STREET

DEDUCT METER - WATER THAT PASSES THROUGH THE DEDUCT METER IS SUBTRACTED FROM THE TOTAL WATER USAGE TO CALCULATE SEWER BILL

WATER LINES ON THE OUTLET SIDE OF THE DEDUCT METER CANNOT CONNECT TO ANY INTERNAL DOMESTIC WATER LINES. THE CITY OF BELLBROOK RESERVES THE RIGHT TO FUTURE INSPECTIONS.




THE DEDUCT METER MUST BE INSTALLED USING METER SWIVEL COUPLINGS. THE PICTURES ABOVE ARE ONLY SAMPLES OF MANY DIFFERENT TYPES AVAILABLE

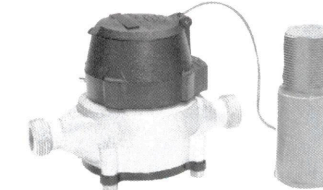

ACTUAL METER

ORION TRANSMITTER TO BE STRAPPED TO PLUMBING OR MOUNTED NEAR METER

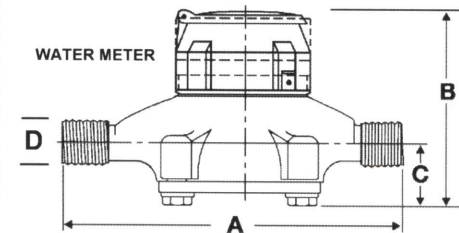

A = 7 1/2" - B = 5 1/4" - C = 1 11/16"
 D = 3/4" (NPT)

THE METER SHALL BE INSTALLED SO THAT IT IS EASILY ACCESSIBLE FOR FUTURE INSPECTIONS OR REPLACEMENT.

THE METER SHALL BE INSTALLED AT LEAST 12" ABOVE THE FLOOR AND A MINIMUM OF 18" CLEARANCE FROM THE TOP OF THE METER

THE DEDUCT WATER METER OR WATER LINES **CANNOT** BE USED FOR UNDERGROUND IRRIGATION SYSTEMS



INSIDE DEDUCT WATER METER

CITY OF BELLBROOK
 UTILITY DEPARTMENT
 937-848-4638